


1. INSTALL BOX CHASSIS TO RACEWAY BASE. END KIT & RACEWAY BASE EDGE MUST BE INSTALLED FIRST IF MOUNTING BOX ON RACEWAY BASE END.
2. MAKE WIRING CONNECTIONS AS REQUIRED, AND INSTALL DECORA UNITS AND 45mm SOCKET TO MOUNTING PLATES.
3. INSTALL COVER PLATE AND END CAPS WITH SUPPLIED SCREWS.

Classification: CTS/DTS 3.102 Flushfloor, 3.103 Onfloor, Service Unit 3.105, 6.101.1 Dry-Treatment Only,  
6.2.6 10J Impact, 6.102.3 1,000 N Small Surface Load, 6.4.1 Flame Propagating  
IP41; Min Storage Temp - 25°C; Installation and Application Temp - 15°C to 60°C

POWER COMPARTMENT VOLUME	
1G	319 cm <sup>3</sup>
2G	630 cm <sup>3</sup>

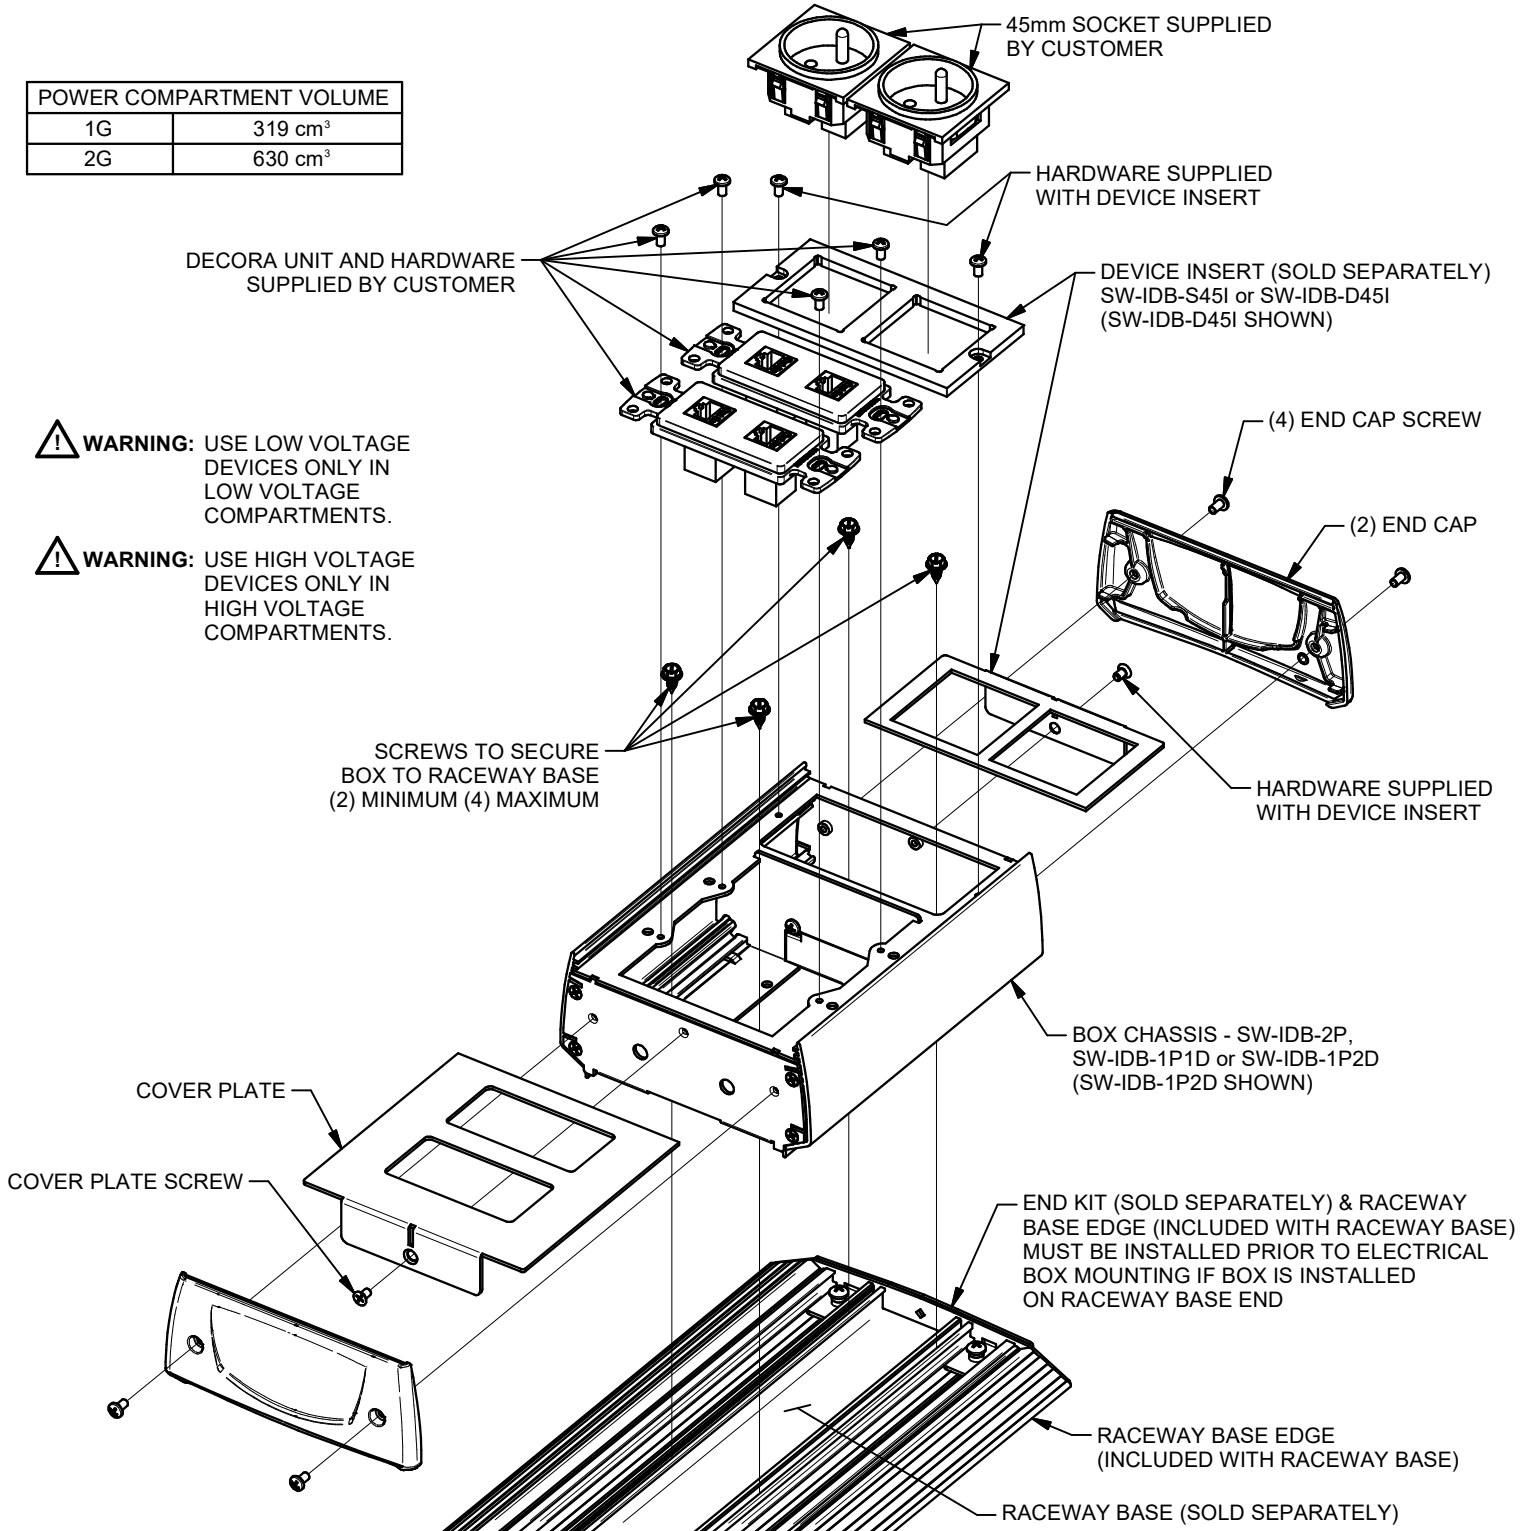

**WARNING:** USE LOW VOLTAGE DEVICES ONLY IN LOW VOLTAGE COMPARTMENTS.

**WARNING:** USE HIGH VOLTAGE DEVICES ONLY IN HIGH VOLTAGE COMPARTMENTS.